



	(mg/L) TDS	1000 (ac-ft) Flow
1940	302	1,110
1941	302	1,110
1942	294	1,135
1943	263	1,636
1944	285	1,232
1945	300	1,135
1946	300	1,209
1947	256	1,853
1948	298	1,125
1949	293	1,188
1950	248	2,046
1951	261	1,855
1952	289	1,496
1953	304	1,084
1954	276	1,183
1955	322	833
1956	270	1,611
1957	268	1,543
1958	314	1,047
1959	308	952
1960	331	698
1961	354	559
1962	265	1,453
1963	301	1,002
1964	287	1,136
1965	313	1,963
1966	379	911
1967	276	1,523
1968	345	975
1969	302	1,362
1970	367	933
1971	287	1,748
1972	282	2,008
1973	350	1,193
1974	306	1,494

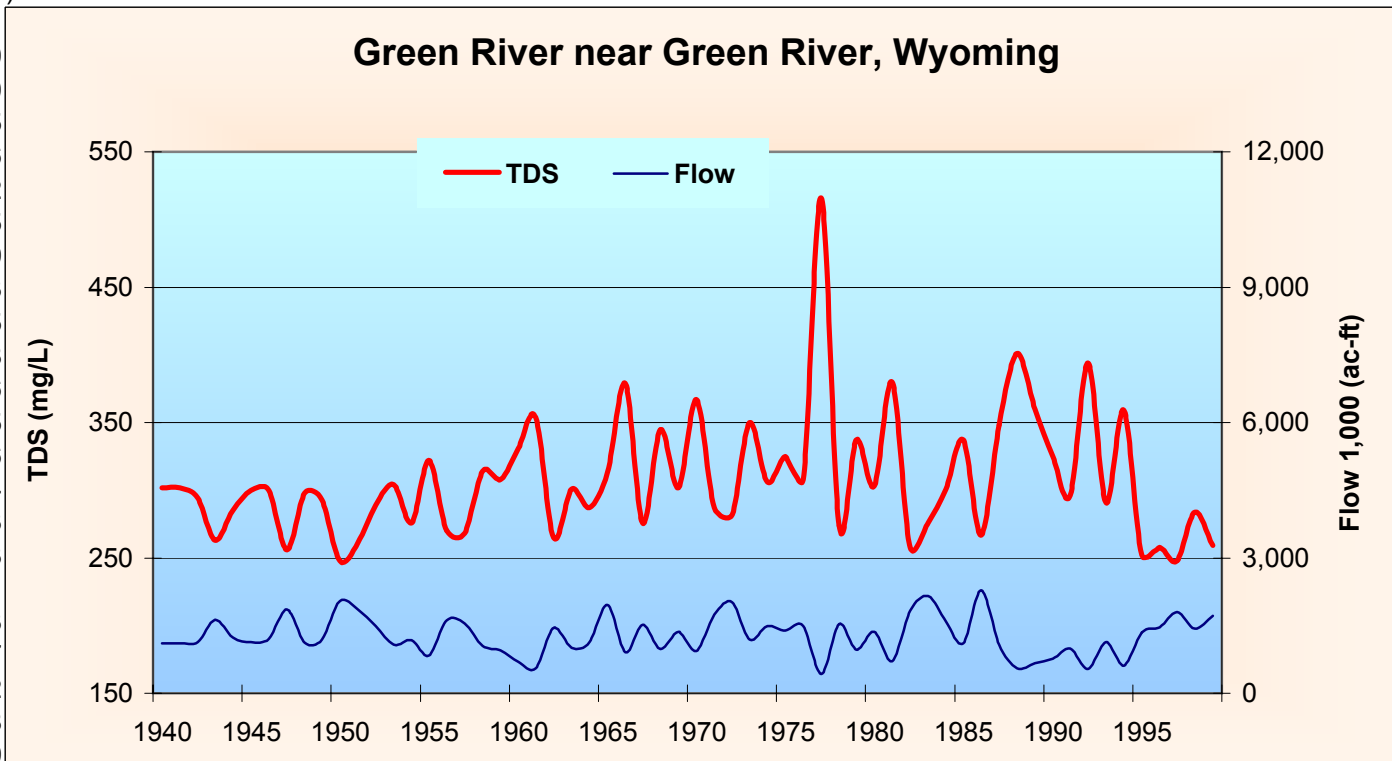


1975	325	1,385
1976	308	1,487
1977	516	431
1978	274	1,532
1979	337	968
1980	303	1,359
1981	380	712
1982	258	1,832
1983	276	2,152
1984	301	1,594
1985	337	1,111
1986	267	2,279
1987	348	1,077
1988	401	559
1989	360	667
1990	325	762
1991	296	999
1992	394	544
1993	291	1,128
1994	359	610
1995	252	1,345
1996	258	1454
1997	248	1805
1998	284	1432
1999	259	1723

	(mg/L) TDS	1000 (ac-ft) Flow
1940	380	1,410
1941	380	1,410
1942	372	1,443
1943	351	2,098
1944	365	1,569
1945	381	1,443
1946	378	1,539
1947	347	2,381
1948	374	1,430
1949	373	1,512
1950	341	2,631
1951	349	2,329
1952	350	2,135
1953	383	1,276
1954	381	1,246
1955	401	1,018
1956	356	1,884
1957	327	2,008
1958	351	1,311
1959	390	1,187
1960	414	972
1961	431	780
1962	376	2,021
1963	572	170
1964	442	1,258
1965	522	1,435
1966	519	1,188
1967	566	1,804
1968	524	1,691
1969	499	1,988
1970	462	1,088
1971	464	1,309
1972	459	2,083
1973	484	1,931
1974	504	1,438

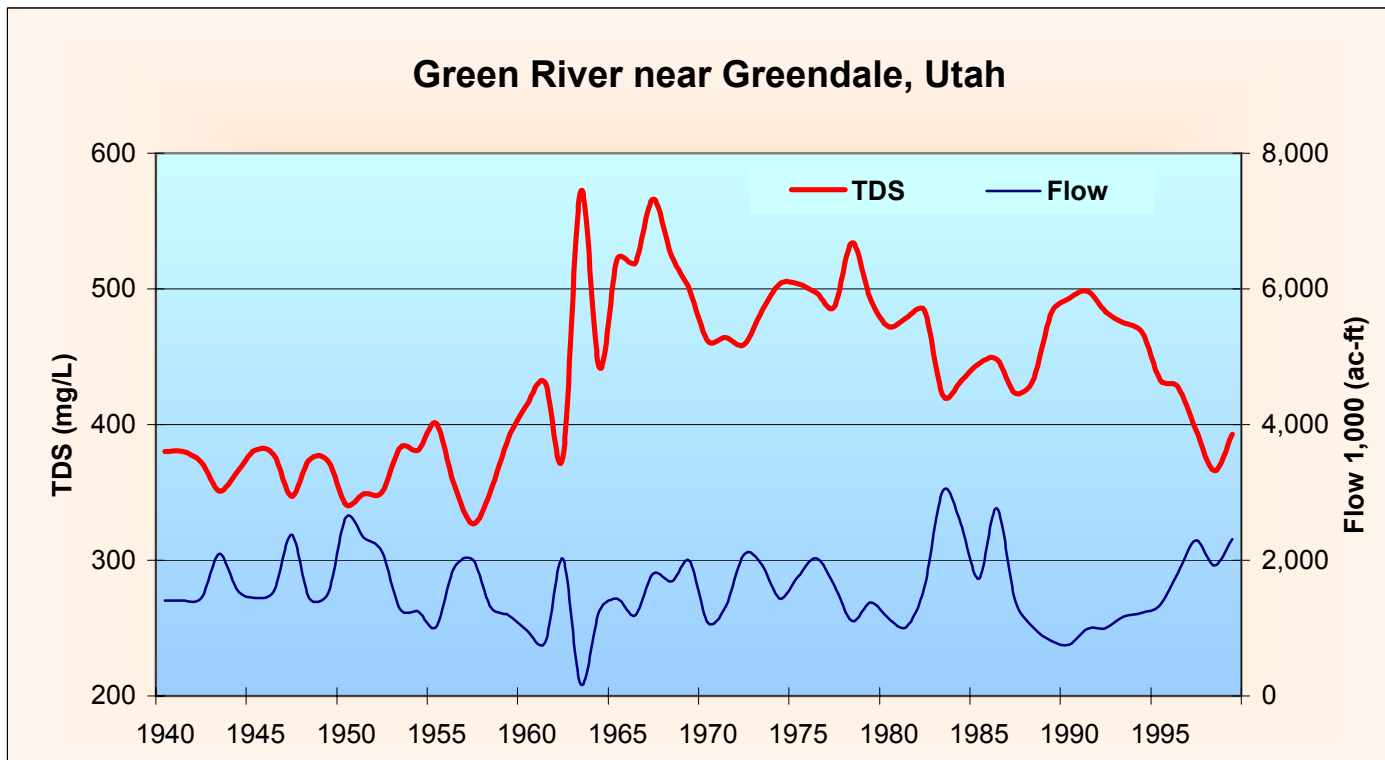

1975	504	1,754
1976	497	2,028
1977	487	1,633
1978	534	1,101
1979	492	1,377
1980	472	1,139
1981	479	1,022
1982	484	1,616
1983	421	3,033
1984	432	2,524
1985	445	1,731
1986	448	2,763
1987	423	1,396
1988	433	1,005
1989	482	810
1990	493	757
1991	498	992
1992	483	1,001
1993	475	1,167
1994	468	1,227
1995	433	1,338
1996	428	1810
1997	396	2291
1998	366	1925
1999	393	2308

	(mg/L) TDS	1000 (ac-ft) Flow
1940	159	1,027
1941	159	1,027
1942	152	1,134
1943	167	903
1944	156	851
1945	145	1,258
1946	173	868
1947	149	1,332
1948	156	1,143
1949	145	1,332
1950	161	942
1951	126	1,016
1952	136	1,436
1953	141	828
1954	157	538
1955	142	764
1956	133	1,022
1957	142	1,832
1958	150	1,227
1959	139	869
1960	139	955
1961	154	706
1962	161	1,423
1963	163	610
1964	149	879
1965	132	1,355
1966	171	663
1967	159	908
1968	156	1,158
1969	156	1,120
1970	163	1,352
1971	164	1,453
1972	154	919
1973	278	1,221
1974	146	1,398

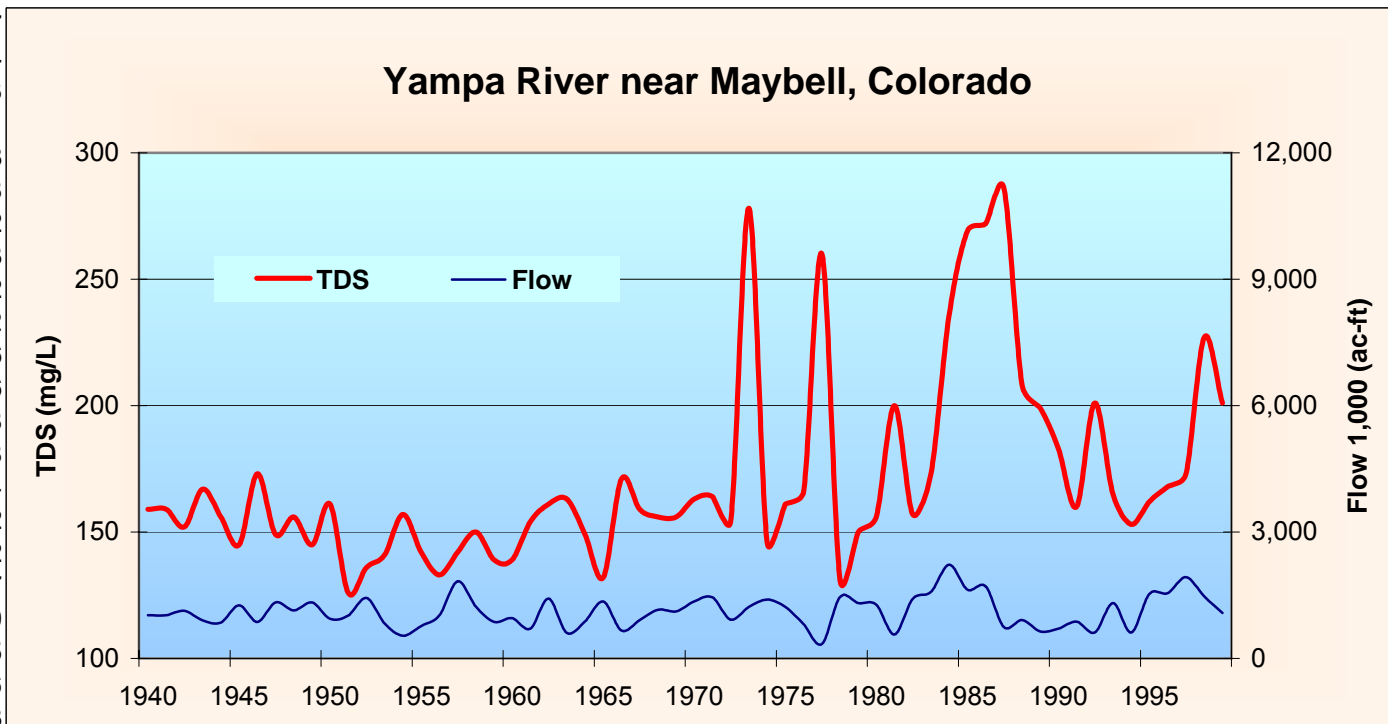

1975	161	1,219
1976	166	810
1977	260	345
1978	131	1,456
1979	150	1,313
1980	156	1,276
1981	200	570
1982	157	1,413
1983	173	1,576
1984	236	2,227
1985	269	1,636
1986	272	1,712
1987	286	742
1988	208	913
1989	199	637
1990	183	709
1991	160	870
1992	201	613
1993	165	1,313
1994	153	615
1995	162	1,536
1996	168	1548
1997	173	1931
1998	227	1474
1999	201	1076