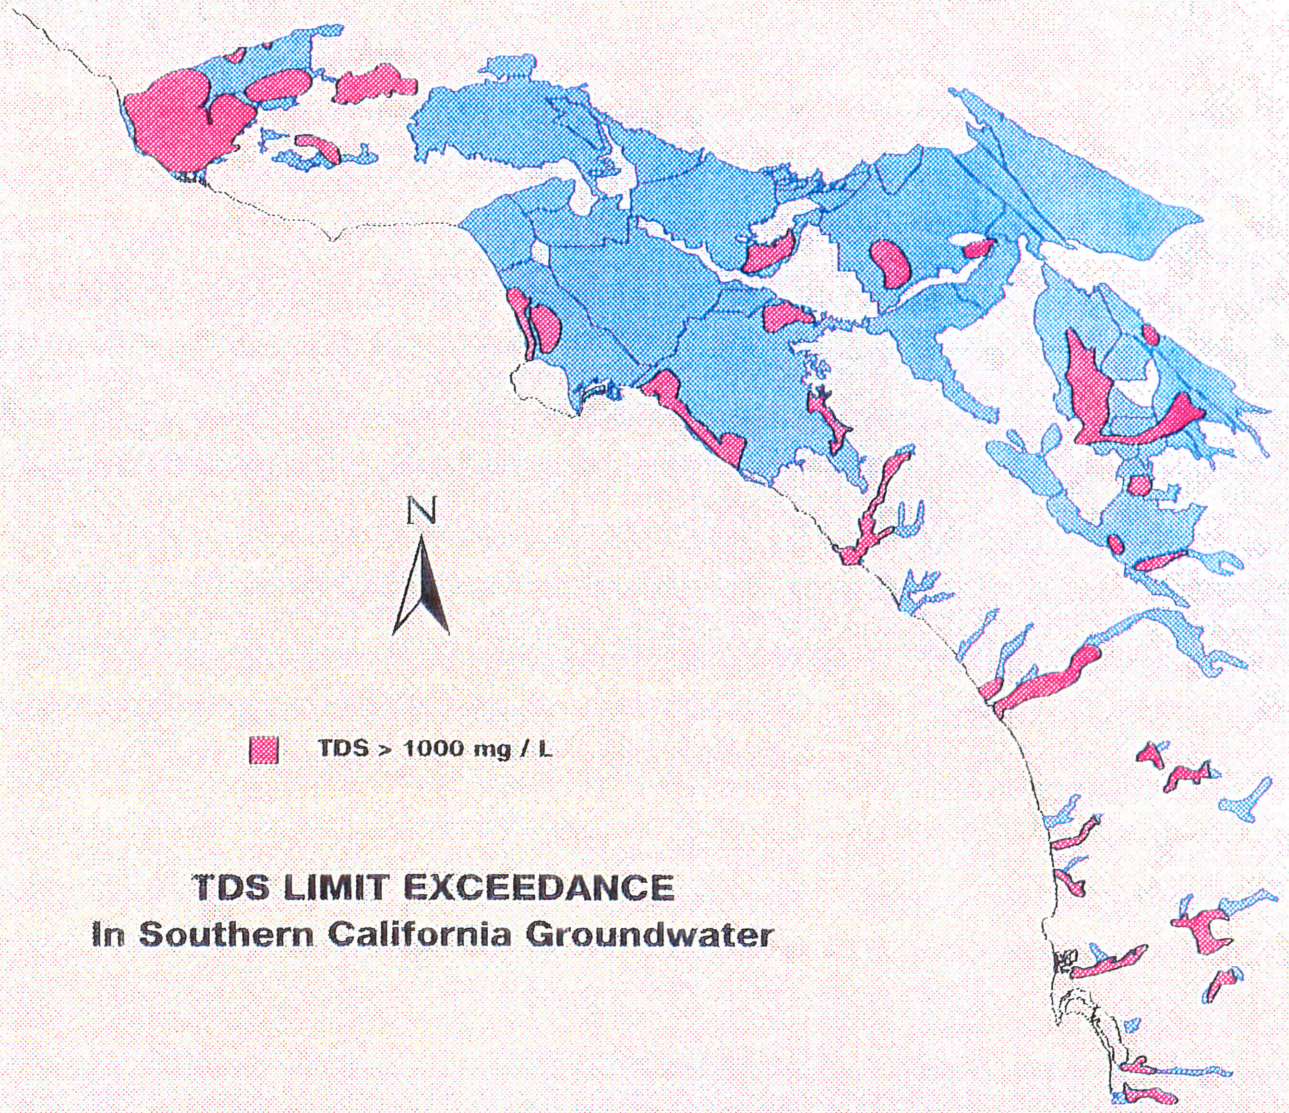

TDS LIMIT EXCEEDANCE
In Southern California Groundwater