



— BUREAU OF —
RECLAMATION

Boysen Reservoir Operations

Water Supply Forecasts and Reservoir Operations



Prepared December 2025

End of November Elevation and Storage: 4711.85 FT & 518,797 Acre-Feet

Actual Inflows (1,000 Acre-Feet):

<u>Month</u>	<u>Inflow</u>	<u>Percent of Normal</u>
November 24	38.2	77
December 24	35.6	90
January 25	26.3	69
February 25	31.3	81
March 25	50.8	95
April 25	42.5	81
May 25	97.3	68
June 25	143.6	48
July 25	37.1	27
August 25	30.9	61
September 25	26.5	56
October 25	39.5	69
November 25	42.4	85

BOYSEN RESERVOIR

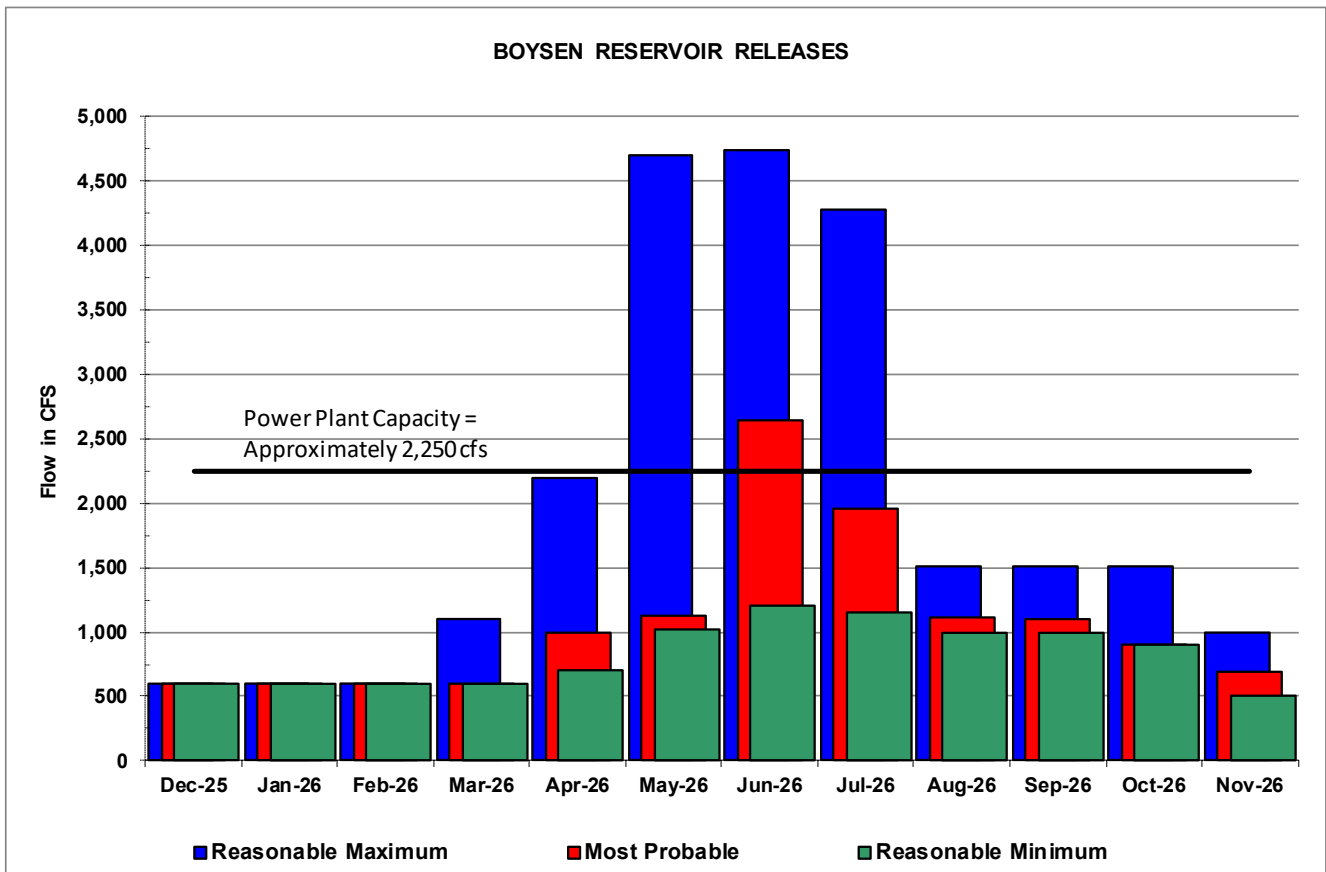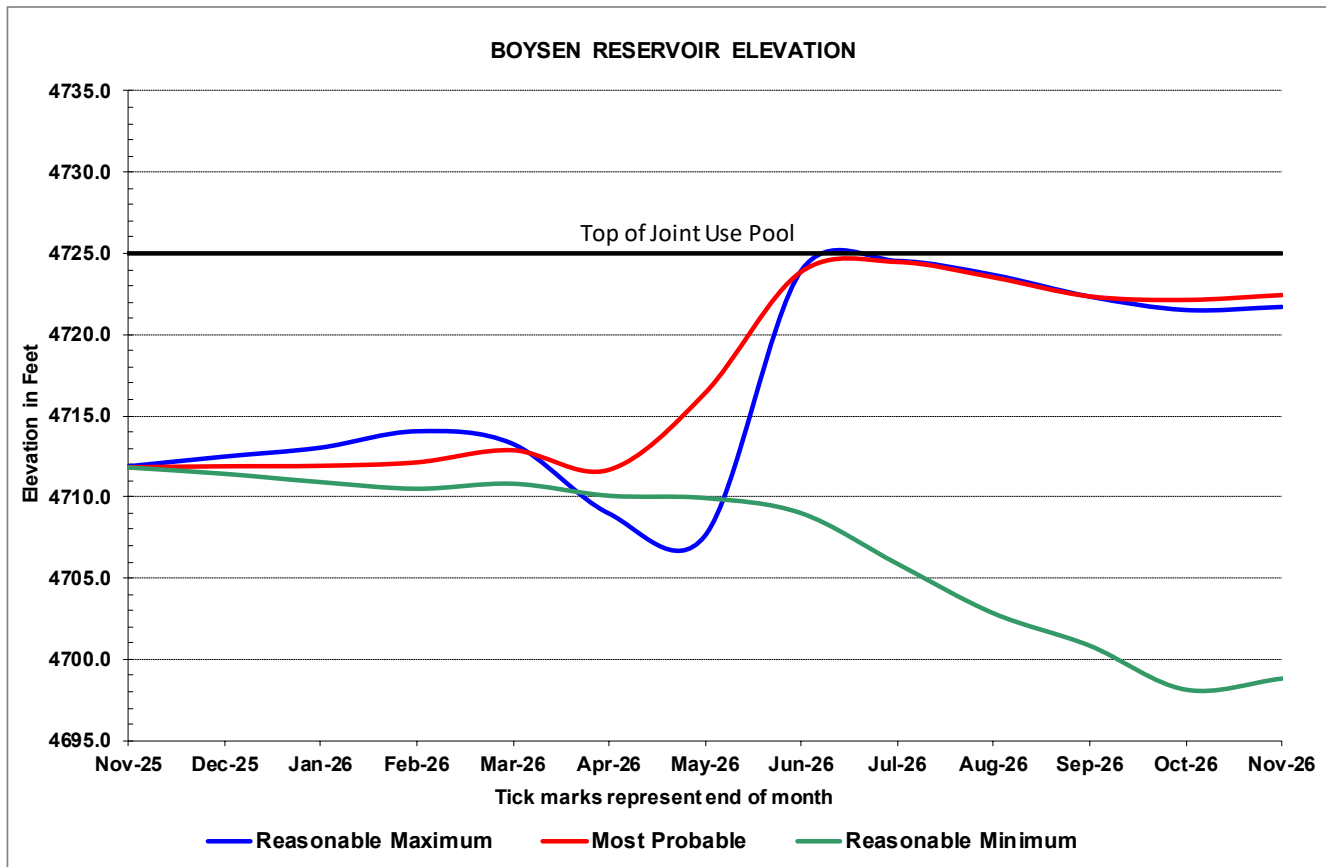

BOYAOP V1.48 Run: 01-Dec-2025 12:29
Based on MOST probable inflows.

BOYSEN RESERVOIR MONTHLY OPERATIONS														
Boysen Reservoir		Initial Cont		518.8 kaf		Maximum Cont		892.2 kaf		Minimum Cont		219.2 kaf		
		Elev		4711.85 ft		Elev		4732.20 ft		Elev		4685.00 ft		
	2025	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Total
Monthly Inflow	kaf	37.8	37.3	36.4	47.8	42.0	140.2	289.2	132.5	50.0	43.5	51.1	46.6	954.4
Monthly Inflow	cfs	615	607	655	777	706	2280	4860	2155	813	731	831	783	
Turbine Release	kaf	36.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	65.5	55.3	15.4	173.1
Bypass/Spill/Waste	kaf	0.0	36.9	33.3	36.9	59.5	68.9	157.1	120.6	68.3	0.0	0.0	25.6	607.1
Total Release	kaf	36.9	36.9	33.3	36.9	59.5	68.9	157.1	120.6	68.3	65.5	55.3	41.0	780.2
Total Release	cfs	600	600	600	600	1000	1121	2640	1961	1111	1101	899	689	
End-Month Content	kaf	519.7	520.1	523.2	534.1	516.6	587.9	720.0	731.9	713.6	691.6	687.4	693.0	
End-Month Elevation	ft	4711.91	4711.94	4712.15	4712.90	4711.69	4716.41	4723.89	4724.50	4723.55	4722.38	4722.16	4722.46	
Net Change Content	kaf	0.9	0.4	3.1	10.9	-17.5	71.3	132.1	11.9	-18.3	-22.0	-4.2	5.6	174.2
Boysen Power Plant	2025	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Total
Turbine Release	kaf	36.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	65.5	55.3	15.4	173.1
Turbine Release	cfs	600	0	0	0	0	0	0	0	0	1101	899	259	
Generation	gwh	3.013	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	5.889	4.957	1.386	15.245
Max Generation	gwh	11.904	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	11.520	11.904	1.382	36.710
% Max Generation	%	25	0	0	0	0	0	0	0	0	51	42	100	
Ave kwh/af		82									90	90	90	88
End-Month Power Cap	mw	16	16	16	16	15	16	16	16	16	16	16	16	

BOYAOP V1.48 Run: 01-Dec-2025 12:30
Based on Reasonable MINIMUM Inflows.

BOYSEN RESERVOIR MONTHLY OPERATIONS														
Boysen Reservoir		Initial Cont		518.8 kaf		Maximum Cont		892.2 kaf		Minimum Cont		219.2 kaf		Total
		Elev		4711.85 ft		Elev		4732.20 ft		Elev		4685.00 ft		
	2025	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	
Monthly Inflow	kaf	31.3	29.7	27.6	41.2	31.4	61.0	58.7	30.0	24.2	36.3	25.0	37.3	433.7
Monthly Inflow	cfs	509	483	497	670	528	992	986	488	394	610	407	627	
Turbine Release	kaf	36.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	59.5	55.3	15.4	167.1
Bypass/Spill/Waste	kaf	0.0	36.9	33.3	36.9	41.7	63.0	71.4	70.7	61.5	0.0	0.0	14.4	429.8
Total Release	kaf	36.9	36.9	33.3	36.9	41.7	63.0	71.4	70.7	61.5	59.5	55.3	29.8	596.9
Total Release	cfs	600	600	600	600	701	1025	1200	1150	1000	1000	899	501	
End-Month Content	kaf	513.2	506.0	500.3	504.6	494.3	492.3	479.6	438.9	401.6	378.4	348.1	355.6	
End-Month Elevation	ft	4711.46	4710.95	4710.54	4710.85	4710.11	4709.97	4709.04	4705.93	4702.88	4700.89	4698.18	4698.86	
Net Change Content	kaf	-5.6	-7.2	-5.7	4.3	-10.3	-2.0	-12.7	-40.7	-37.3	-23.2	-30.3	7.5	-163.2
Boysen Power Plant	2025	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Total
Turbine Release	kaf	36.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	59.5	55.3	15.4	167.1
Turbine Release	cfs	600	0	0	0	0	0	0	0	0	1000	899	259	
Generation	gwh	3.006	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	4.165	3.738	1.039	11.948
Max Generation	gwh	11.904	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	11.520	11.904	1.382	36.710
% Max Generation	%	25	0	0	0	0	0	0	0	0	36	31	75	
Ave kwh/af		81									70	68	67	72
End-Month Power Cap	mw	16	15	15	15	15	15	15	14	13	12	12	12	

BOYAOP V1.48 Run: 01-Dec-2025 12:34
Based on reasonable MAXIMUM Inflows.

BOYSEN RESERVOIR MONTHLY OPERATIONS														
Boysen Reservoir		Initial Cont		518.8 kaf		Maximum Cont		892.2 kaf		Minimum Cont		219.2 kaf		
		Elev		4711.85 ft		Elev		4732.20 ft		Elev		4685.00 ft		
	2025	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Total
Monthly Inflow	kaf	45.7	44.9	48.3	56.1	70.2	270.6	541.9	274.6	76.3	65.0	77.6	63.0	1634.2
Monthly Inflow	cfs	743	730	870	912	1180	4401	9107	4466	1241	1092	1262	1059	
Turbine Release	kaf	36.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	90.0	92.9	15.5	235.3
Bypass/Spill/Waste	kaf	0.0	36.9	33.3	67.6	130.9	289.0	281.9	262.7	92.9	0.0	0.0	44.0	1239.2
Total Release	kaf	36.9	36.9	33.3	67.6	130.9	289.0	281.9	262.7	92.9	90.0	92.9	59.5	1474.5
Total Release	cfs	600	600	600	1099	2200	4700	4737	4272	1511	1513	1511	1000	
End-Month Content	kaf	527.6	535.6	550.6	539.1	478.4	460.0	720.0	731.9	715.3	690.3	675.0	678.5	
End-Month Elevation	ft	4712.45	4713.00	4714.01	4713.24	4708.95	4707.57	4723.89	4724.50	4723.64	4722.31	4721.48	4721.67	
Net Change Content	kaf	8.8	8.0	15.0	-11.5	-60.7	-18.4	260.0	11.9	-16.6	-25.0	-15.3	3.5	159.7
Boysen Power Plant	2025	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Total
Turbine Release	kaf	36.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	90.0	92.9	15.5	235.3
Turbine Release	cfs	600	0	0	0	0	0	0	0	0	1513	1511	260	
Generation	gwh	3.021	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	8.046	8.223	1.378	20.668
Max Generation	gwh	11.904	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	11.520	11.904	1.382	36.710
% Max Generation	%	25	0	0	0	0	0	0	0	0	70	69	100	
Ave kwh/af		82									89	89	89	88
End-Month Power Cap	mw	16	16	16	16	14	13	16	16	16	16	16	16	