



— BUREAU OF —
RECLAMATION

Boysen Reservoir Operations

Water Supply Forecasts and Reservoir Operations



Prepared August 2026

End of July Elevation and Storage: 4712.8 FT & 532,609 Acre-Feet

Actual Inflows (1,000 Acre-Feet):

<u>Month</u>	<u>Inflow</u>	<u>Percent of Normal</u>
July 25	37.1	27
August 25	30.9	61
September 25	26.5	56
October 25	39.5	69
November 25	42.4	85
December 25	39.5	99
January 26	35.4	94
February 26	36.2	96
March 26	45.4	85
April 26	44.1	84
May 26	62.0	44
June 26	98.5	34
July 26	46.4	37

BOYSEN RESERVOIR

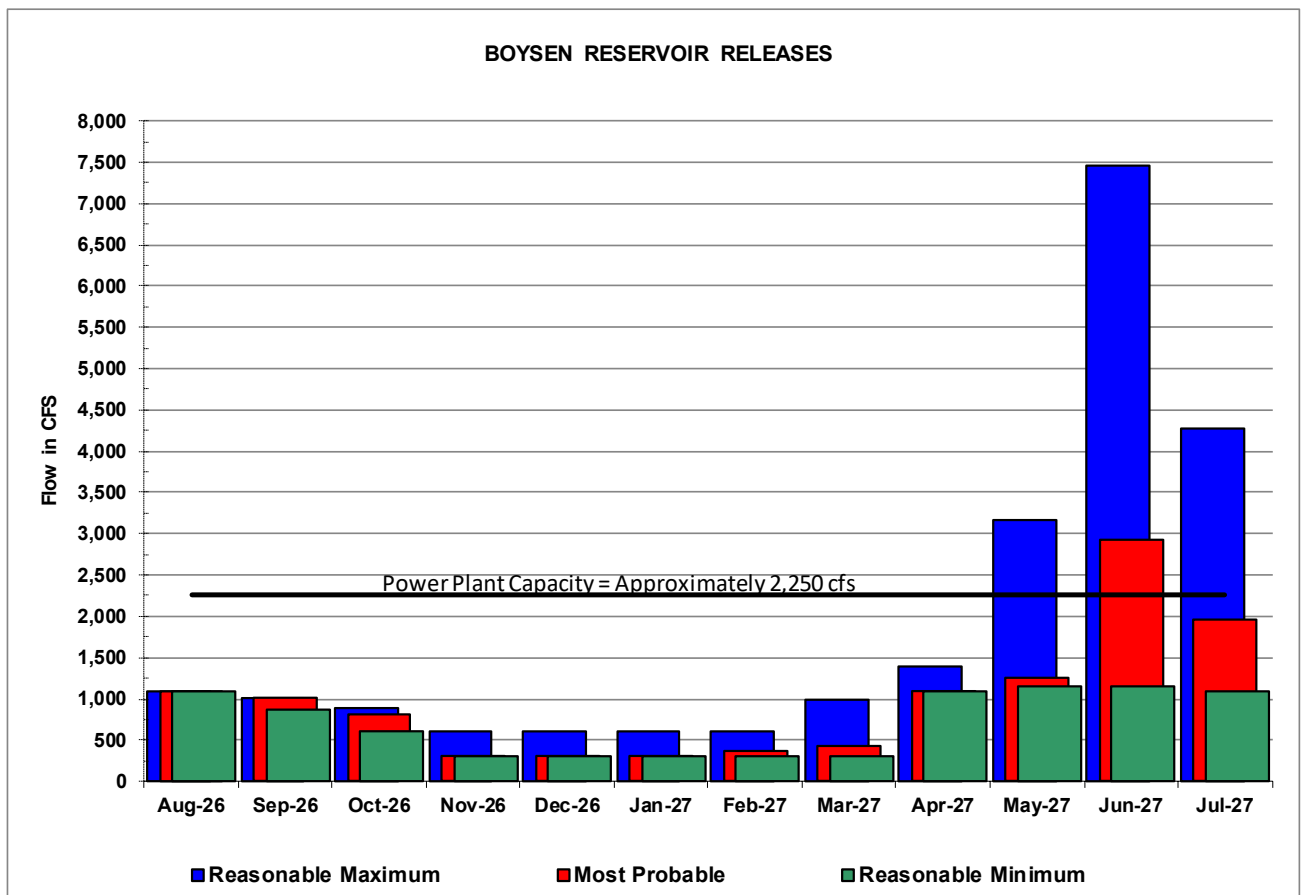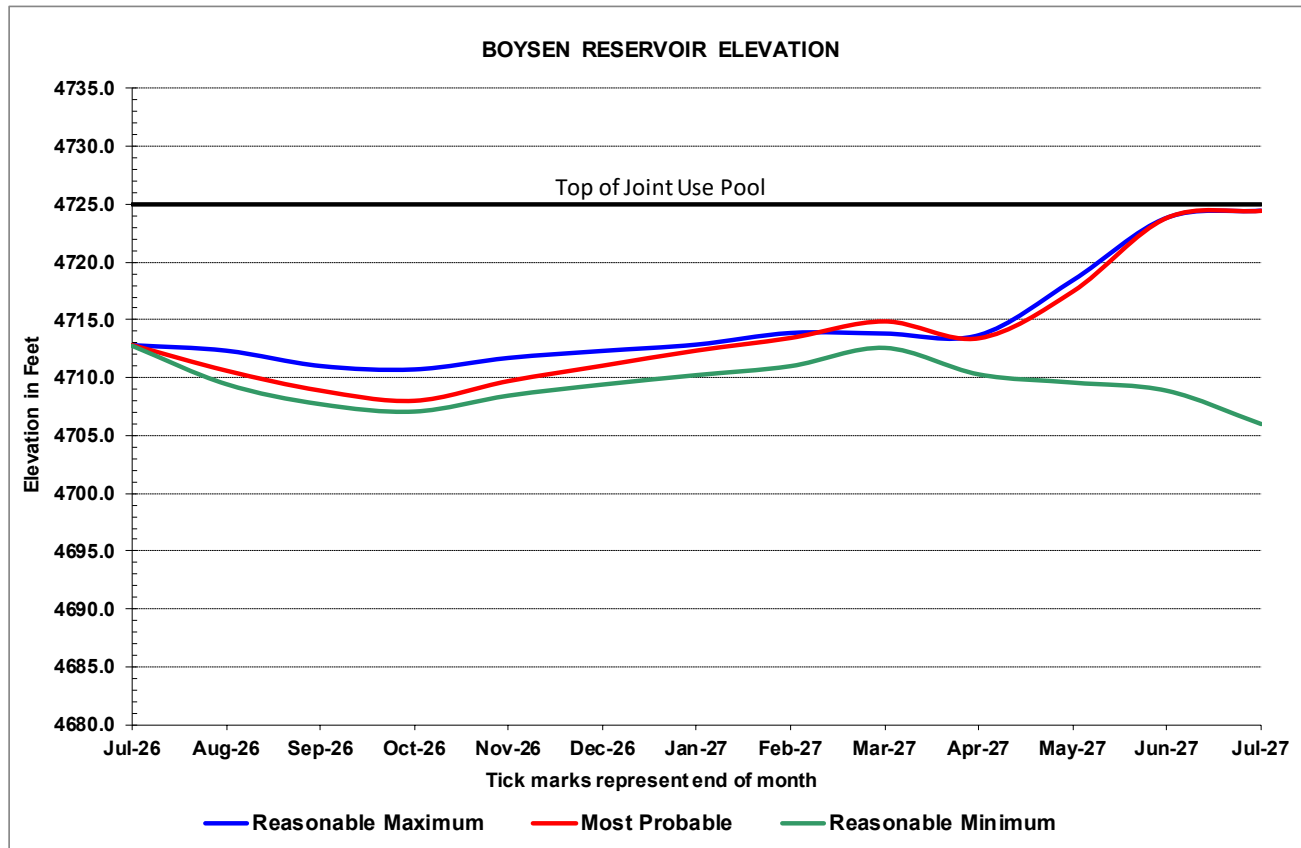

BOYAOP V1.48 Run: 03-Aug-2026 15:03
Based on Most Probable Inflows.

[illegible]

V1.48 Run: 03-Aug-2026 15:04
Based on reasonable MINIMUM inflows.

Boysen Reservoir		BOYSEN RESERVOIR MONTHLY OPERATIONS													
		Initial Cont			532.6 kaf		Maximum Cont			892.2 kaf		Minimum Cont		219.2 kaf	
		Elev	4712.80 ft			Elev	4732.20 ft			Elev	4685.00 ft				
	2026	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Total	
Monthly Inflow	kaf	20.0	27.9	28.4	36.2	31.3	29.7	27.6	41.2	31.4	61.0	58.7	29.9	423.3	
Monthly Inflow	cfs	325	469	462	608	509	483	497	670	528	992	986	486		
Turbine Release	kaf	67.0	51.2	36.9	17.9	18.4	18.4	16.7	18.4	64.3	70.1	67.6	67.6	514.5	
Bypass/Spill/Waste	kaf	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6	0.8	0.0	1.4	
Total Release	kaf	67.0	51.2	36.9	17.9	18.4	18.4	16.7	18.4	64.3	70.7	68.4	67.6	515.9	
Total Release	cfs	1090	860	600	301	299	299	301	299	1081	1150	1150	1099		
End-Month Content	kaf	485.6	462.3	453.8	472.1	485.0	496.3	507.2	530.0	497.1	487.4	477.7	440.0		
End-Month Elevation	ft	4709.48	4707.74	4707.10	4708.48	4709.44	4710.26	4711.04	4712.62	4710.32	4709.61	4708.90	4706.02		
Net Change Content	kaf	-47.0	-23.3	-8.5	18.3	12.9	11.3	10.9	22.8	-32.9	-9.7	-9.7	-37.7	-92.6	
Boysen Power Plant	2026	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Total	
Turbine Release	kaf	67.0	51.2	36.9	17.9	18.4	18.4	16.7	18.4	64.3	70.1	67.6	67.6	514.5	
Turbine Release	cfs	1090	860	600	301	299	299	301	299	1081	1140	1136	1099		
Generation	gwh	5.377	3.996	2.853	1.411	1.472	1.485	1.359	1.515	5.178	5.539	5.285	5.151	40.621	
Max Generation	gwh	5.952	5.760	5.952	5.760	5.952	5.952	5.376	5.952	5.760	5.952	5.760	5.952	70.080	
% Max Generation	%	90	69	48	24	25	25	25	25	90	93	92	87		
Ave kwh/af		80	78	77	79	80	81	81	82	81	79	78	76	79	
End-Month Power Cap	mw	15	14	14	15	15	15	16	16	15	15	15	14		

BOYAOP V1.48 Run: 03-Aug-2026 15:04
Based on Reasonable Maximum inflows.

[illegible]