



— BUREAU OF —
RECLAMATION

Boysen Reservoir Operations

Water Supply Forecasts and Reservoir Operations



Prepared June 2026

End of May Elevation and Storage: 4712.04 FT & 521,537 Acre-Feet

Actual Inflows (1,000 Acre-Feet):

<u>Month</u>	<u>Inflow</u>	<u>Percent of Normal</u>
May 25	97.3	68
June 25	143.6	48
July 25	37.1	27
August 25	30.9	61
September 25	26.5	56
October 25	39.5	69
November 25	42.4	85
December 25	39.5	99
January 26	35.4	94
February 26	36.2	96
March 26	45.4	85
April 26	44.1	84
May 26	62.0	44

BOYSEN RESERVOIR

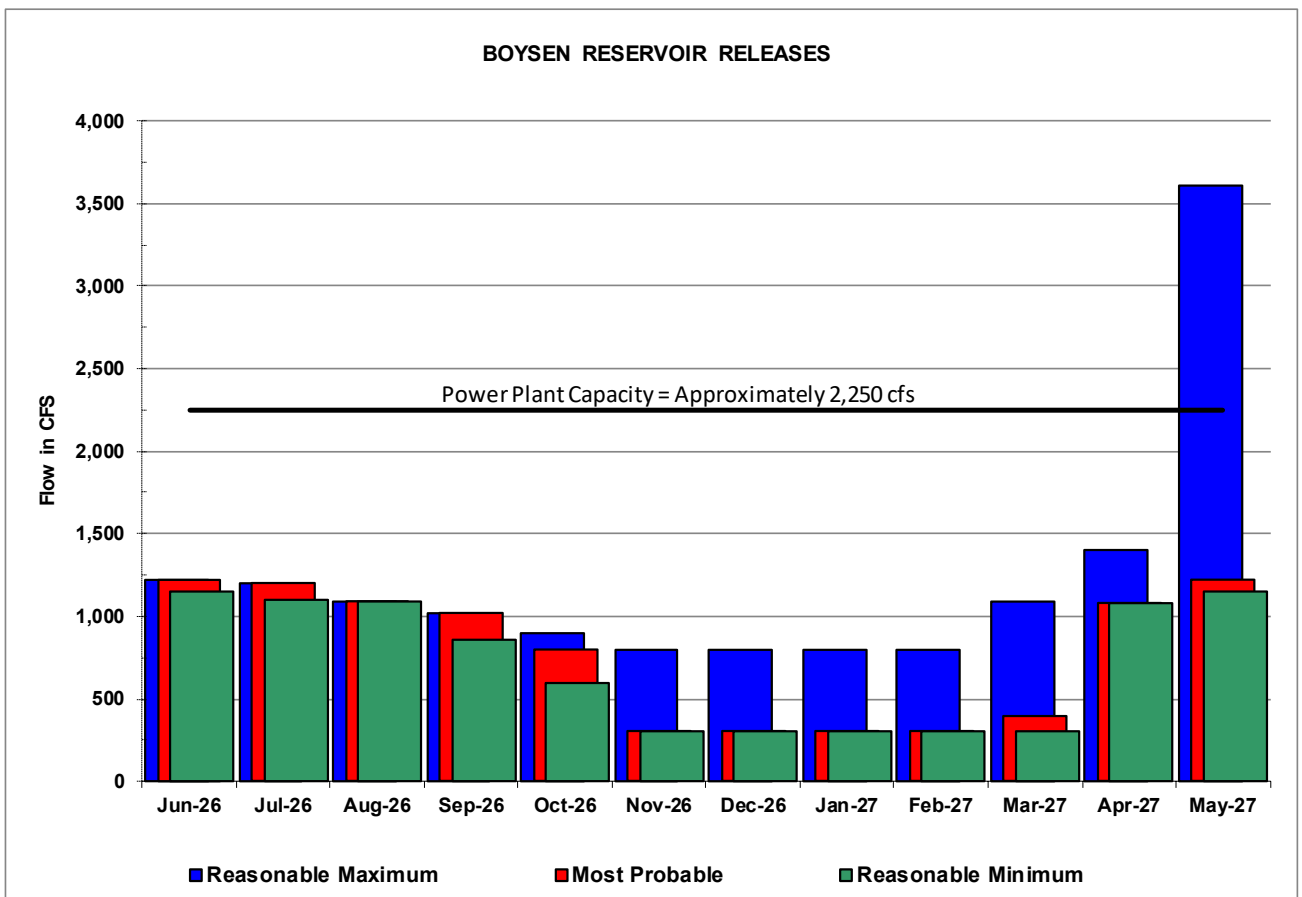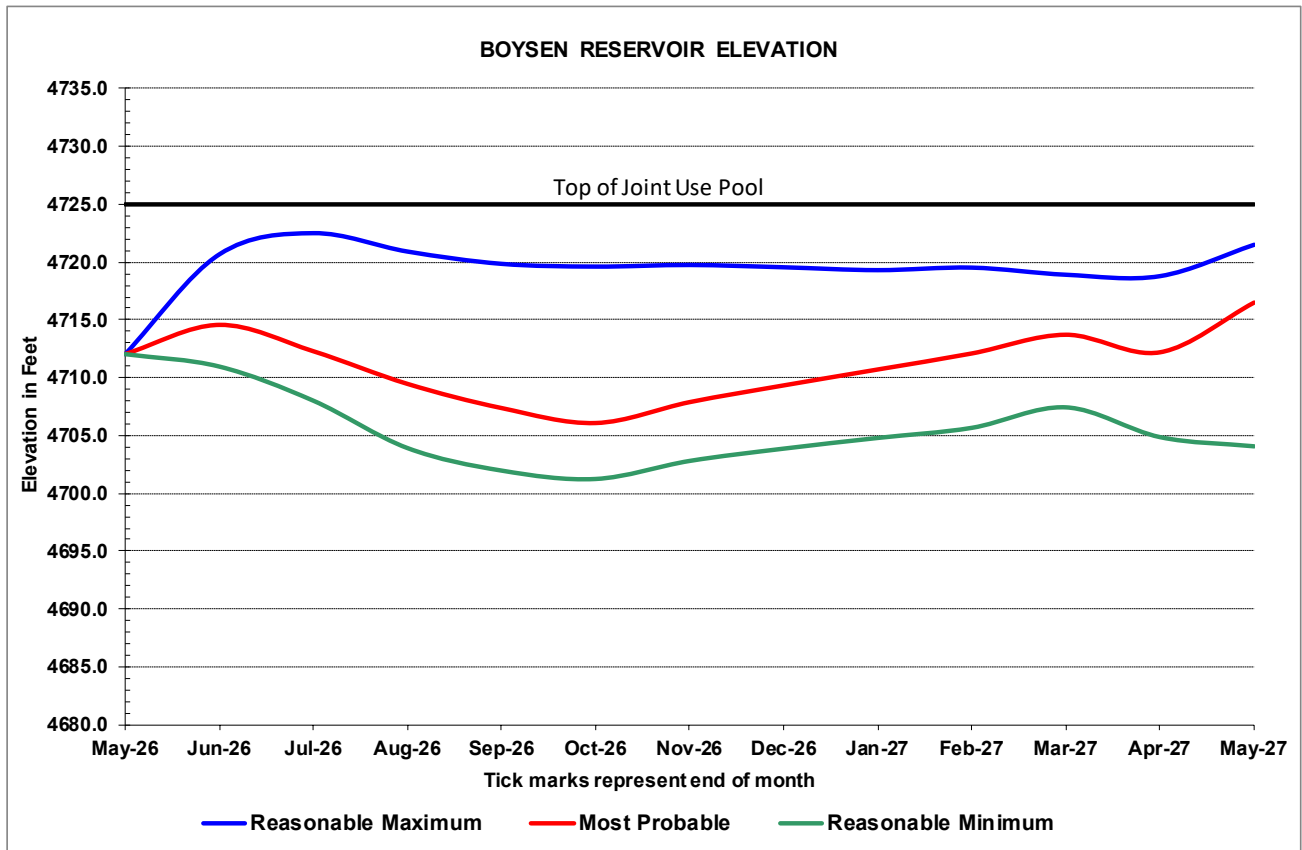

BOYAOP V1.48 Run: 02-Jun-2026 08:14
 Based on Most Probable June - July Inflows of 150 KAF.

BOYSEN RESERVOIR MONTHLY OPERATIONS														
Boysen Reservoir	2026	Initial Cont		521.5 kaf		Maximum Cont		892.2 kaf		Minimum Cont		219.2 kaf		Total
		Jun	Jul	Elev	4712.04 ft	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	
Monthly Inflow	kaf	110.0	40.0	27.4	32.8	32.7	41.1	37.8	37.3	36.4	47.8	42.0	140.2	625.5
Monthly Inflow	cfs	1849	651	446	551	532	691	615	607	655	777	706	2280	
Turbine Release	kaf	69.0	71.3	67.0	60.7	49.2	17.9	18.4	18.4	16.7	24.1	64.3	71.6	548.6
Bypass/Spill/Waste	kaf	3.6	2.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.4	9.5
Total Release	kaf	72.6	73.8	67.0	60.7	49.2	17.9	18.4	18.4	16.7	24.1	64.3	75.0	558.1
Total Release	cfs	1220	1200	1090	1020	800	301	299	299	301	392	1081	1220	
End-Month Content	kaf	558.9	525.1	485.5	457.6	441.1	464.3	483.7	502.6	522.3	546.0	523.7	588.9	
End-Month Elevation	ft	4714.55	4712.28	4709.47	4707.39	4706.10	4707.90	4709.34	4710.71	4712.09	4713.70	4712.19	4716.47	
Net Change Content	kaf	37.4	-33.8	-39.6	-27.9	-16.5	23.2	19.4	18.9	19.7	23.7	-22.3	65.2	67.4

BOYAOP V1.48 Run: 02-Jun-2026 08:14
 Based on reasonable MINIMUM June - July Inflows of 80 KAF.

BOYSEN RESERVOIR MONTHLY OPERATIONS														
Boysen Reservoir	2026	Initial Cont		521.5 kaf		Maximum Cont		892.2 kaf		Minimum Cont		219.2 kaf		Total
		Jun	Jul	Elev	4712.04 ft	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	
Monthly Inflow	kaf	53.0	27.0	15.0	27.9	28.4	36.2	31.3	29.7	27.6	41.2	31.4	61.0	409.7
Monthly Inflow	cfs	891	439	244	469	462	608	509	483	497	670	528	992	
Turbine Release	kaf	68.4	67.6	67.0	51.2	36.9	17.9	18.4	18.4	16.7	18.4	64.3	68.0	513.2
Bypass/Spill/Waste	kaf	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.7	2.7
Total Release	kaf	68.4	67.6	67.0	51.2	36.9	17.9	18.4	18.4	16.7	18.4	64.3	70.7	515.9
Total Release	cfs	1150	1099	1090	860	600	301	299	299	301	299	1081	1150	
End-Month Content	kaf	506.1	465.5	413.5	390.2	381.7	400.0	412.9	424.2	435.1	457.9	425.0	415.3	
End-Month Elevation	ft	4710.96	4707.99	4703.87	4701.91	4701.18	4702.75	4703.82	4704.75	4705.63	4707.41	4704.82	4704.02	
Net Change Content	kaf	-15.4	-40.6	-52.0	-23.3	-8.5	18.3	12.9	11.3	10.9	22.8	-32.9	-9.7	-106.2

V1.48 Run: 02-Jun-2026 08:25
 Based on Reasonable Maximum June - July Inflows of 320 KAF.

BOYSEN RESERVOIR MONTHLY OPERATIONS														
Boysen Reservoir	2026	Initial Cont		521.5 kaf		Maximum Cont		892.2 kaf		Minimum Cont		219.2 kaf		Total
		Jun	Jul	Elev	4712.04 ft	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	
Monthly Inflow	kaf	212.4	107.6	37.6	41.6	51.1	50.0	45.7	44.9	48.3	56.1	81.3	270.6	1047.2
Monthly Inflow	cfs	3570	1750	612	699	831	840	743	730	870	912	1366	4401	
Turbine Release	kaf	68.1	67.1	66.9	60.7	55.3	47.6	49.2	49.2	44.4	67.0	66.8	69.8	712.1
Bypass/Spill/Waste	kaf	4.5	6.7	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	16.5	152.3	180.1
Total Release	kaf	72.6	73.8	67.0	60.7	55.3	47.6	49.2	49.2	44.4	67.0	83.3	222.1	892.2
Total Release	cfs	1220	1200	1090	1020	899	800	800	800	799	1090	1400	3612	
End-Month Content	kaf	661.3	695.1	665.7	646.6	642.4	644.8	641.3	637.0	640.9	630.0	628.0	676.5	
End-Month Elevation	ft	4720.72	4722.57	4720.97	4719.90	4719.66	4719.80	4719.60	4719.35	4719.57	4718.95	4718.83	4721.56	
Net Change Content	kaf	139.8	33.8	-29.4	-19.1	-4.2	2.4	-3.5	-4.3	3.9	-10.9	-2.0	48.5	155.0

Boysen Power Plant 2026 Jun Jul Aug Sep Oct Nov Dec Jan Feb Mar Apr May Total

Turbine Release kaf 68.1 67.1 66.9 60.7 55.3 47.6 49.2 49.2 44.4 67.0 66.8 69.8 712.1

Turbine Release cfs 1144 1091 1088 1020 899 800 800 800 799 1090 1123 1135

Generation gwh 5.758 5.952 5.951 5.339 4.844 4.175 4.315 4.306 3.885 5.821 5.756 5.954 62.056

Max Generation gwh 5.760 5.952 5.952 5.760 5.952 5.760 5.952 5.952 5.376 5.952 5.760 5.952 70.080

% Max Generation % 100 100 100 93 81 72 72 72 72 98 100 100

Ave kwh/af 85 89 89 88 88 88 88 88 88 87 86 85 87

End-Month Power Cap mw 16 16 16 16 16 16 16 16 16 16 16 16 16