



— BUREAU OF —
RECLAMATION

Boysen Reservoir Operations

Water Supply Forecasts and Reservoir Operations



Prepared October 2026

End of September Elevation and Storage: 4710.16 FT & 494,913 Acre-Feet

Actual Inflows (1,000 Acre-Feet):

<u>Month</u>	<u>Inflow</u>	<u>Percent of Normal</u>
September 25	26.5	56
October 25	39.5	69
November 25	42.4	85
December 25	39.5	99
January 26	35.4	94
February 26	36.2	96
March 26	45.4	85
April 26	44.1	84
May 26	62.0	44
June 26	98.5	34
July 26	46.4	37
August 26	32.7	66
September 26	45.0	97

BOYSEN RESERVOIR

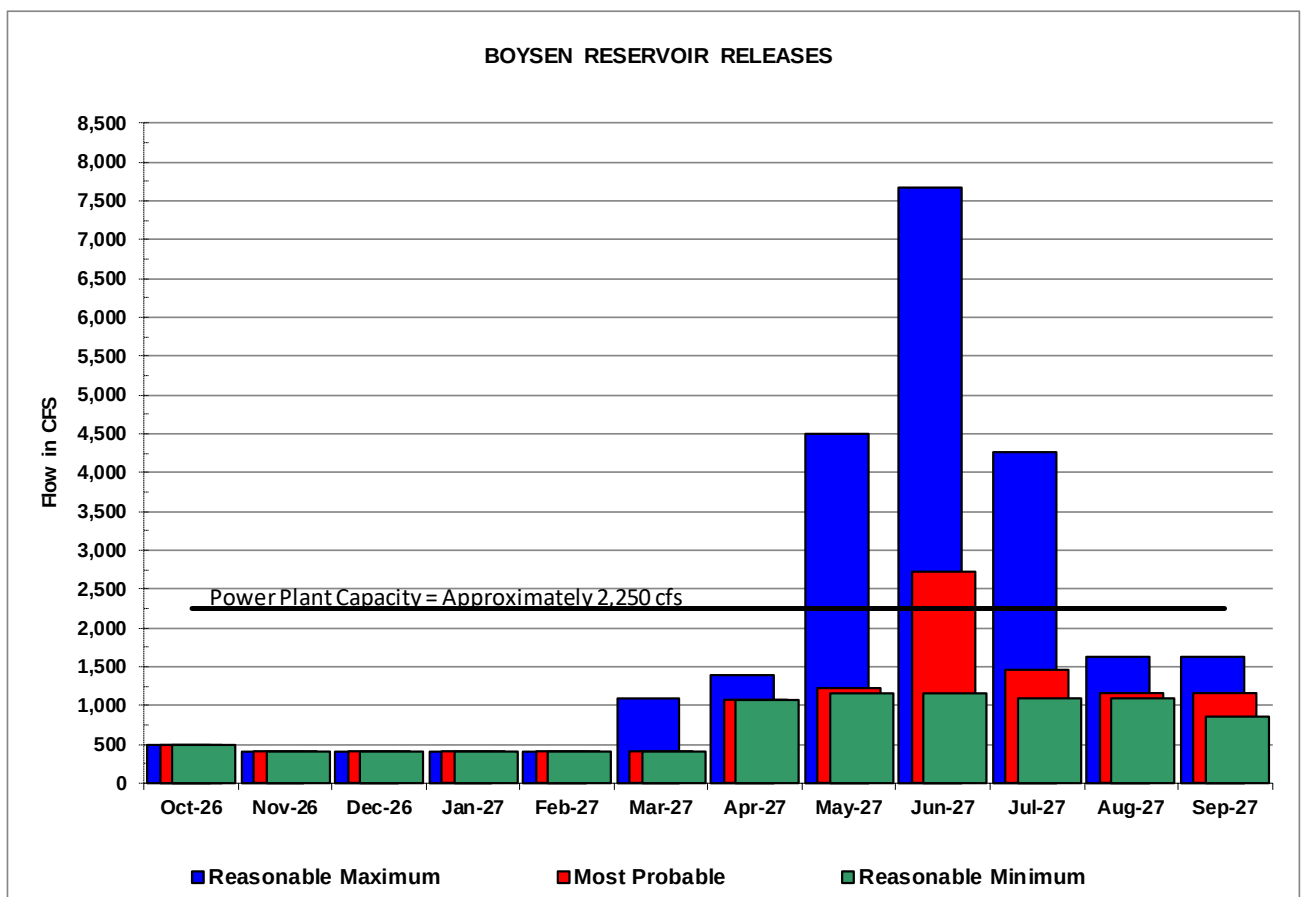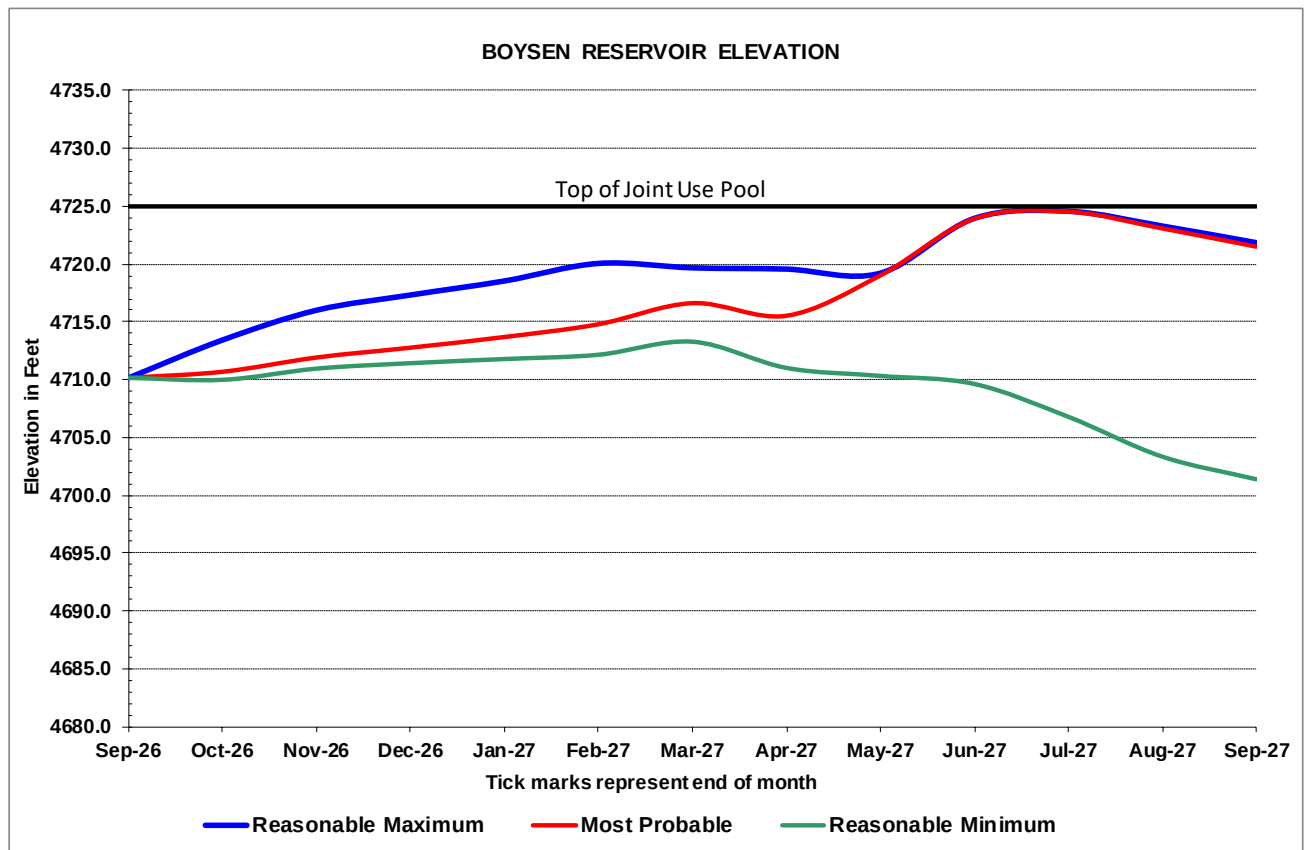

BOYAOP V1.48 Run: 01-Oct-2026 15:49
Based on Most Probable Inflows.

Boysen Reservoir		BOYSEN RESERVOIR MONTHLY OPERATIONS												Total
		Initial Cont			494.9 kaf		Maximum Cont			892.2 kaf		Minimum Cont		
			Elev	4710.16			Elev	4732.20			Elev	4685.00		
	2026	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Monthly Inflow	kaf	38.0	41.3	37.0	38.2	38.8	53.5	47.1	132.1	251.2	101.3	44.0	40.3	862.8
Monthly Inflow	cfs	618	694	602	621	699	870	792	2148	4222	1647	716	677	
Turbine Release	kaf	11.4	0.0	0.0	0.0	0.0	0.0	64.3	69.9	66.2	65.8	65.8	64.5	427.2
Bypass/Spill/Waste	kaf	19.3	23.8	24.6	24.6	22.2	24.9	0.0	5.1	95.8	23.6	6.0	4.9	255.5
Total Release	kaf	30.7	23.8	24.6	24.6	22.2	24.9	64.3	75.0	162.0	89.4	71.8	69.4	682.7
Total Release	cfs	499	400	400	400	400	405	1081	1220	2723	1454	1168	1166	
End-Month Content	kaf	502.2	519.7	532.1	545.7	562.3	590.9	573.7	630.8	720.0	731.9	704.1	675.0	
End-Month Elevation	ft	4710.68	4711.91	4712.76	4713.68	4714.78	4716.60	4715.51	4718.99	4723.89	4724.50	4723.05	4721.48	
Net Change Content	kaf	7.3	17.5	12.4	13.6	16.6	28.6	-17.2	57.1	89.2	11.9	-27.8	-29.1	180.1
Boysen Power Plant	2026	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Total
Turbine Release	kaf	11.4	0.0	0.0	0.0	0.0	0.0	64.3	69.9	66.2	65.8	65.8	64.5	427.2
Turbine Release	cfs	185	0	0	0	0	0	1081	1137	1113	1070	1070	1084	
Generation	gwh	0.933	0.000	0.000	0.000	0.000	0.000	5.419	5.948	5.760	5.952	5.954	5.757	37.267
Max Generation	gwh	0.952	0.000	0.000	0.000	0.000	0.000	5.760	5.952	5.760	5.952	5.952	5.760	44.659
% Max Generation	%	98	0	0	0	0	0	94	100	100	100	100	100	
Ave kwh/af		82						84	85	87	90	90	89	87
End-Month Power Cap	mw	15	16	16	16	16	16	16	16	16	16	16	16	

BOYAOP V1.48 Run: 01-Oct-2026 15:49
Based on reasonable MINIMUM inflows.

Boysen Reservoir		BOYSEN RESERVOIR MONTHLY OPERATIONS																							
		Initial Cont				494.9 kaf				Maximum Cont				892.2 kaf				Minimum Cont				219.2 kaf			
		Elev		4710.16 ft		Elev		4732.20 ft		Elev		4685.00 ft													
2026	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Total												
Monthly Inflow	kaf	28.4	37.3	31.3	29.7	27.6	41.2	31.4	61.0	58.7	29.9	24.2	28.1	428.8											
Monthly Inflow	cfs	462	627	509	483	497	670	528	992	986	486	394	472												
Turbine Release	kaf	11.3	0.0	0.0	0.0	0.0	0.0	64.3	70.3	67.8	67.6	67.0	51.2	399.5											
Bypass/Spill/Waste	kaf	19.4	23.8	24.6	24.6	22.2	24.6	0.0	0.4	0.6	0.0	0.0	0.0	140.2											
Total Release	kaf	30.7	23.8	24.6	24.6	22.2	24.6	64.3	70.7	68.4	67.6	67.0	51.2	539.7											
Total Release	cfs	499	400	400	400	400	400	1081	1150	1150	1099	1090	860												
End-Month Content	kaf	492.6	506.1	512.8	517.9	523.3	539.9	507.0	497.3	487.6	449.9	407.1	384.0												
End-Month Elevation	ft	4709.99	4710.96	4711.43	4711.79	4712.16	4713.29	4711.02	4710.33	4709.63	4706.79	4703.34	4701.38												
Net Change Content	kaf	-2.3	13.5	6.7	5.1	5.4	16.6	-32.9	-9.7	-9.7	-37.7	-42.8	-23.1	-110.9											
Boysen Power Plant	2026	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Total											
Turbine Release	kaf	11.3	0.0	0.0	0.0	0.0	0.0	64.3	70.3	67.8	67.6	67.0	51.2	399.5											
Turbine Release	cfs	184	0	0	0	0	0	1081	1143	1139	1099	1090	860												
Generation	gwh	0.908	0.000	0.000	0.000	0.000	0.000	5.214	5.607	5.359	5.211	4.922	3.627	30.848											
Max Generation	gwh	0.952	0.000	0.000	0.000	0.000	0.000	5.760	5.952	5.760	5.952	5.952	5.760	36.088											
% Max Generation	%	95	0	0	0	0	0	91	94	93	88	83	63												
Ave kwh/af		80						81	80	79	77	73	71	77											
End-Month Power Cap	mw	15	16	16	16	16	16	15	15	15	14	13	13												

BOYAOP V1.48 Run: 01-Oct-2026 15:49
Based on Reasonable Maximum inflows.

BOYSEN RESERVOIR MONTHLY OPERATIONS															
Boysen Reservoir		Initial Cont			494.9 kaf		Maximum Cont			892.2 kaf		Minimum Cont		219.2 kaf	
			Elev	4710.16	ft		Elev	4732.20	ft		Elev	4685.00	ft		
	2026	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Total	
Monthly Inflow	kaf	77.6	63.0	45.7	44.9	48.3	60.7	81.3	270.6	541.9	274.6	76.3	65.0	1649.9	
Monthly Inflow	cfs	1262	1059	743	730	870	987	1366	4401	9107	4466	1241	1092		
Turbine Release	kaf	11.4	0.0	0.0	0.0	0.0	40.9	66.4	70.9	68.4	67.5	66.1	64.9	456.5	
Bypass/Spill/Waste	kaf	19.3	23.8	24.6	24.6	22.2	26.4	16.9	205.8	387.3	195.2	34.6	32.6	1013.3	
Total Release	kaf	30.7	23.8	24.6	24.6	22.2	67.3	83.3	276.7	455.7	262.7	100.7	97.5	1469.8	
Total Release	cfs	499	400	400	400	400	1095	1400	4500	7658	4272	1638	1639		
End-Month Content	kaf	541.8	581.0	602.1	622.4	648.5	641.9	639.9	633.8	720.0	731.9	707.5	675.0		
End-Month Elevation	ft	4713.42	4715.98	4717.29	4718.50	4720.01	4719.63	4719.52	4719.17	4723.89	4724.50	4723.23	4721.48		
Net Change Content	kaf	46.9	39.2	21.1	20.3	26.1	-6.6	-2.0	-6.1	86.2	11.9	-24.4	-32.5	180.1	
Boysen Power Plant	2026	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Total	
Turbine Release	kaf	11.4	0.0	0.0	0.0	0.0	40.9	66.4	70.9	68.4	67.5	66.1	64.9	456.5	
Turbine Release	cfs	185	0	0	0	0	665	1116	1153	1150	1098	1075	1091		
Generation	gwh	0.933	0.000	0.000	0.000	0.000	3.572	5.759	5.956	5.761	5.948	5.948	5.760	39.637	
Max Generation	gwh	0.952	0.000	0.000	0.000	0.000	3.571	5.760	5.952	5.760	5.952	5.952	5.760	39.659	
% Max Generation	%	98	0	0	0	0	100	100	100	100	100	100	100		
Ave kwh/af		82					87	87	84	84	88	90	89	87	
End-Month Power Cap	mw	16	16	16	16	16	16	16	16	16	16	16	16		