



NOTES:

- ① KEY RIPRAP INTO EXISTING RIVER BANK.
- ② KEY RIPRAP INTO GRADE OF APPROACH APRON.
- ③ SEE SECTION.
- ④ TRANSITION TOP OF BANK BACK TO EXISTING.
- ⑤ ALL RIPRAP PLACED ABOVE THE WATER SURFACE SHALL BE BEDDED IN FILTER MATERIAL. THICKNESS OF THE FILTER MATERIAL SHALL BE AT LEAST 1/2 THE THICKNESS OF THE RIPRAP.
- ⑥ REVEGETATE TOP OF BANK. (SEE NOTE 2).
- ⑦ RESEED DISTURBED AREAS.
- ⑧ LIMITS OF DISTURBANCE.
- ⑨ OURAY WILDLIFE RESERVE.
- ⑩ NEW 14" PVC C900 PURPLE IRRIGATION PIPE. (C 2003)
- ⑪ EXISTING 12" PVC IRRIGATION PIPE.
- ⑫ PROVIDE 14"x12" REDUCER AND CONNECT TO EXISTING PVC PIPE. PROVIDE FITTINGS AND THRUST BLOCKING AS NEEDED.
- ⑬ PUMP BUILDING.
- ⑭ CONTROL BUILDING.
- ⑮ TRANSFORMER PAD, SEE CONCRETE SLAB SCHEDULE.
- ⑯ EXISTING ELECTRICAL FEED.
- ⑰ CONNECT NEW POWER TO EXISTING POWER.
- ⑱ NEW 2'x2' ELECTRICAL PULL BOX. CONTRACTOR TO COORDINATE LOCATION WITH OWNER.
- ⑲ CONNECT POWER/PIPE TO PRIVATE PUMP STATION.
- ⑳ CONDUIT AND CONDUCTORS. SEE MOON LAKE ELECTRIC. CONTRACTOR TO COORDINATE LOCATION OF TRENCHING AND CONNECTION TO FUSE ENCLOSURE, TRANSFORMER AND METER ENCLOSURE.
- ㉑ FUSE ENCLOSURE. CONTRACTOR TO COORDINATE CONCRETE PAD SIZE AND THICKNESS WITH MOON LAKE ELECTRIC. ENCLOSURE TO BE PROVIDED BY MOON LAKE ELECTRIC.
- ㉒ METER ENCLOSURE. CONTRACTOR TO COORDINATE CONCRETE PAD SIZE AND THICKNESS WITH MOON LAKE ELECTRIC. ENCLOSURE TO BE PROVIDED BY MOON LAKE ELECTRIC.
- ㉓ ANTENNA. (E 5024)
- ㉔ APPROXIMATE FLOW METER LOCATION. FLOW METER INSTALLED BY OTHERS.

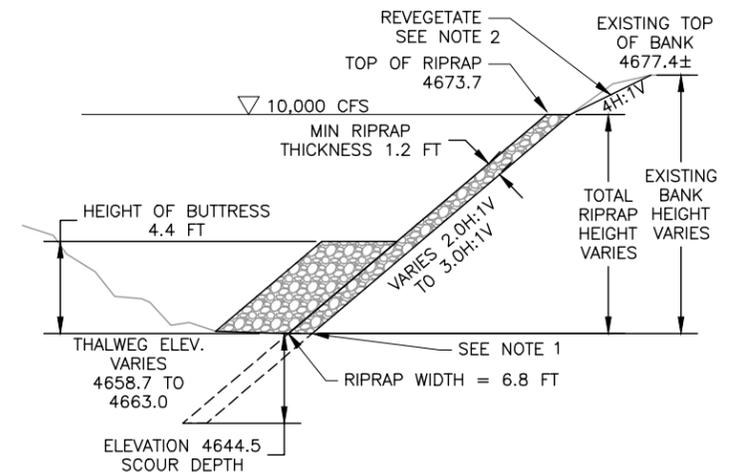

SECTION 1
NTS

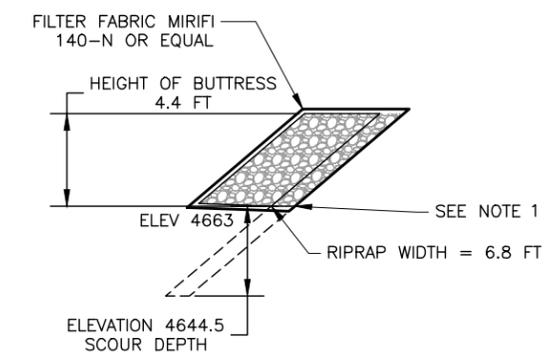

SECTION 2
NTS

SECTION NOTES:

- 1 SEE PLAN VIEW FOR LOCATION AND ELEVATION.
- 2 REVEGETATE WITH LIVE WILLOW PLANTINGS OR OTHER SUITABLE MATERIALS.

Figure 3
GREEN RIVER PUMPING PROJECT
BANK PROTECTION
UNTAH WATER CONSERVANCY DISTRICT

